


## SECTION H PREVENTIVE MAINTENANCE

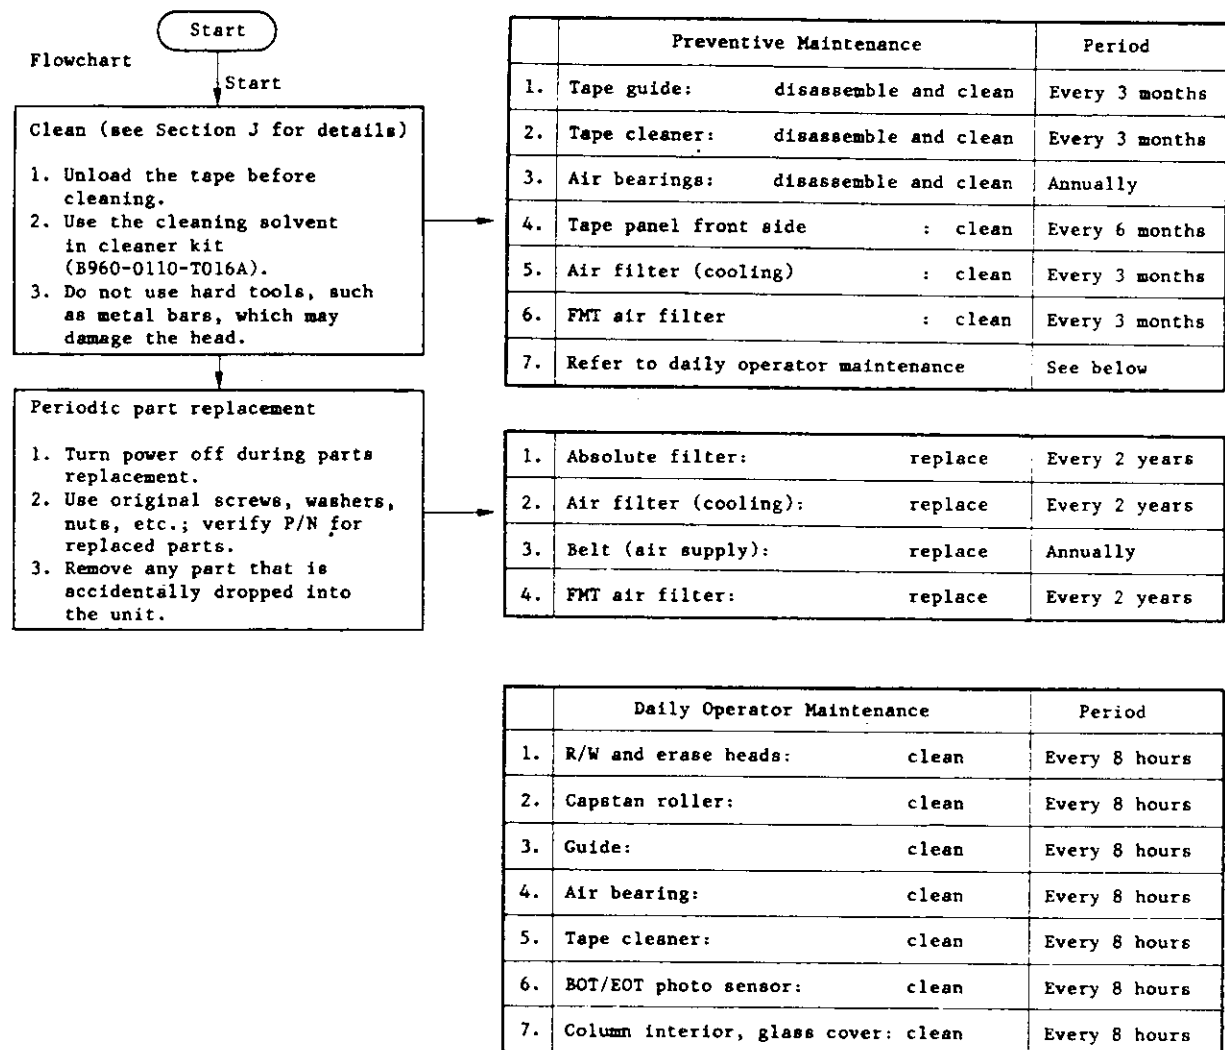

Note: Air filters should be cleaned or replaced every 3 months, and must be replaced every 2 years. See replacement schedule in Section L.